





www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

ICC-ES Evaluation Report ESR-1822

DIVISION: 06 00 00—WOOD, PLASTICS AND

COMPOSITES

Section: 06 05 23—Wood, Plastic and Composite

Fastenings

REPORT HOLDER:

TOBIN STEEL COMPANY, INC.

EVALUATION SUBJECT:

TOBIN STEEL STRUCTURAL WOOD HANGERS AND CONNECTORS

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2021, 2018, 2015, 2012 and 2009 International Building Code® (IBC)
- 2021, 2018, 2015, 2012 and 2009 International Residential Code® (IRC)

Property evaluated:

Structural

2.0 USES

The structural wood hangers and connectors described in this report are used for connecting wood framing members in accordance with IBC Section 2304.10.4 (2018 and 2015 IBC Section 2304.10.3, 2012 and 2009 IBC Section 2304.9.3). They may also be used in structures regulated under the IRC when an engineered design is submitted in accordance with IRC Section R301.1.3.

3.0 DESCRIPTION

3.1 TECC and TCC Series Column Caps:

The TECC and TCC series column caps are used to connect a wood beam to a wood post, and provide both uplift load resistance and download support for the wood beam. The TECC column caps are designed for use at beam ends, while the TCC column caps are used for support of continuous beams. These post caps are fabricated from two either No. 7 or No. 3 gage steel straps factory-welded to either a No. 7 or a No. 3 gage steel U-shaped channel. The U-shaped steel channel is ¹/₈-inch (3.2 mm) wider than the wood beam net width, and the two vertical steel straps have a clear distance 1/8-inch (3.2 mm) wider than the supporting wood post net width. Both the U-channel and vertical steel strap have prepunched holes to receive either 5/8 inch-(15.9 mm) or ³/₄-inch-diameter (19.1 mm) bolts. See Table 1 for column cap models, dimensions, required quantity and diameter of bolts, and allowable uplift loads and downloads. Reissued July 2023

This report is subject to renewal July 2024.

3.2 TF Series Panelized Roof Joist Hangers:

The TF series panelized roof hangers are engineered components for panelized roof construction only. The TF series hangers are fabricated from No. 18 gage galvanized steel. The TF series hangers have a seat width to accommodate sawn-lumber joists. The TF series hangers have vertical flange edges designed to grip the wood joist during installation of the roof panel, without the use of fasteners. The TF series panelized roof joist hangers have prepunched nail holes in the top bearing flange for two 10d common nails used to fasten the hanger to the header. See Table 2 for hanger models, dimensions, fastener schedules, and allowable downloads.

3.3 TVB Series Kneebraces:

The TVB series kneebrace connectors are designed to provide lateral support of the bottom of deep beams by attaching to purlins installed on each side of the beam. The kneebrace connectors are fabricated from No. 12 gage by $2^1/_{16}$ -inch-wide (52 mm) galvanized steel straps. The kneebrace connectors are used in pairs and are nailed to the bottom portion of the braced beam and nailed to the adjacent purlins that are perpendicular to the beam. See Table 3 for models, brace dimensions, fastener schedules, and allowable tension loads.

3.4 TXC Series Purlin Hangers:

The TXC series purlin hangers are top-flange hangers designed to support sawn-lumber purlins having nominal widths shown in Table 4. The top flange is a No. 7 gage equal-leg angle factory-welded to a 0.125-inch-thick (3.2 mm) (base-metal thickness) U-shaped stirrup. The top flange angle is 7 inches (178 mm) long and 2¹/₂ inches (64 mm) deep. See Table 4 for hanger models, hanger dimensions, nominal purlin sizes, fastener schedules, and allowable downloads and uplift loads.

3.5 TXD Series Purlin Hangers:

The TXD series purlin hangers are top-flange hangers that are designed to support sawn-lumber purlins and laminated veneer lumber (LVL) purlins. Each hanger consists of a No. 11 gage hot-rolled steel plate bent into a U-shaped stirrup that is factory-welded to a No. 3 gage unequal-leg, hot-rolled steel angle. The top flange angle is 10 inches (254 mm) long by $2^3/4$ inches (70 mm) deep. The hangers have prepunched holes for installing nails into both the supporting and supported wood members. See Table 5 for hanger models, hanger dimensions, purlin sizes, fastener schedules, and allowable downloads and uplift loads.



3.6 TGLT/THGLT Beam Hangers:

The TGLT/THGLT beam hangers are top-flange hangers that are designed to connect sawn-lumber, glued-laminated or engineered wood beams to a supporting member. The hangers consist of a No. 7 gage, hot-rolled steel plate bent into aU-shaped stirrup that is factory-welded to a No. 3 gage unequal-leg, hot-rolled steel angle. The hangers have prepunched holes for installing N54A nails into the wood members. See Table 6 for hanger models, hangers dimensions, fastener schedules, and allowable downloads and uplift loads.

3.7 TLEG/TMEG/TEG Series Beam Hangers:

The TLEG/TMEG/TEG series beam hangers are designed to connect glued-laminated or engineered wood beams to a supporting member. The TLEG and TMEG series hangers consist of a No. 7 gage, 6-inch-wide (152 mm) steel sheet bent into a U-shaped stirrup that is factory-welded to a No. 3 gage, unequal-leg, steel header angle. The TEG series hangers consist of a No. 3 gage by 6-inch-wide (152 mm) steel sheet bent into a U-shaped stirrup that is factorywelded to a No. 3 gage, unequal-leg, steel header angle. The depth of the top flange of the header angle is $2^{1/2}$ inches (64 mm) for all hangers. The steel U-shaped stirrup is factory-welded to the vertical leg of the steel header angle. The header angle and the U-shaped stirrup have prepunched bolt holes that are 1/16-inch (1.6 mm) larger in diameter than the bolts used to attach the supported beam and the supporting header. See Table 7 for hanger models, hanger dimensions, fastener schedules, and allowable downloads and uplift loads.

3.8 TGLS/THGLS and TGLST/THGLST Series Beam Saddle Hangers:

The TGLS/THGLS series beam saddle hangers are designed to support two horizontally aligned gluedlaminated or sawn-lumber beams on one wood girder. The TGLST and THGLST series beam saddle hangers are designed to connect glued-laminated beams to a girder, and to transfer wind and seismic forces through the girder in drag strut applications. The TGLS series hangers consist of two No. 7 gage by 5-inch-wide (127 mm) hot-rolled steel plates bent into U-shaped stirrups that are factory-welded to a No. 3 gage inverted steel channel with 4-inch-long (102 mm) vertical flanges and a channel web width equal to the width of the supporting wood girder. The THGLS series hangers have two U-shaped stirrups, fabricated from No. 7 gage by 6-inch-wide (152 mm) hot-rolled steel. The TGLST/THGLST hangers are identical to the TGLS/THGLS series beam saddle hangers, except they have tension straps welded to each side of the support saddles that are designed to transfer axial tension forces induced by wind or seismic loading from one carried beam to the other. The TGLS/THGLS series beam saddle hangers are prepunched for N54A nails, and the tension straps for the TGLST/THGLST series beam saddle hangers have oblong holes for installing three ³/₄-inch-diameter (19 mm) bolts on each side of the carrying girder. See Table 8 for beam saddle models, beam saddle dimensions, fastener schedules, and allowable uplift loads, downloads, and lateral loads.

3.9 THC Hinge Connectors (with Optional THCCT Seismic Strap):

The THC hinge connectors are designed to connect two glued-laminated beams, end-to-end, which have the same width and top elevation. The connectors consist of steel top and bottom bearing plates factory-welded to two No. 7 gage steel vertical side plates forming a loop with a parallelogram-

shaped side elevation. Each steel vertical plate has factorywelded top and bottom rotation steel straps with two or three prepunched holes to receive 3/4-inch-diameter (19 mm) bolts that pass through the two beams. The THC hinge connectors are available with the THCCT tension steel straps factorywelded at mid-height of the steel vertical side plates. Each tension steel strap has three prepunched oblong holes to receive 3/4-inch-diameter (19 mm) bolts. See Table 9 for hinge connector models, connector dimensions, fastener schedule, allowable downloads for the connector and allowable tension loads for the connector with tension straps.

3.10 TSL, TSF, TMST, TSI, TSJ, and THST Series Tie Straps:

The TSL, TSF, TMST, TSI, TSJ, and THST series tie straps are designed to connect various wood framing members together to resist tension forces. The TSL, TSF, TSI, and TSJ series tie straps are fastened with nails; the TSMT series tie straps are fastened with either nails or bolts, but not both; and the THST series tie straps are fastened with bolts. See Table 10 for tie strap models, strap dimensions, fastener schedules, and allowable tension loads.

3.11 TCMST Series Coil Straps:

The TCMST12 and TCMST14 coil straps are used to create a continuous tie across multiple roof framing members, or they may be cut to length as prescribed by the building designer. Multiple lengths and multiple nail spacing options are listed in the load tables. Ultimate strap load value is limited to the steel allowable strength in tension. See Table 10 and Figure 10E for coil strap models, strap dimensions, fastener schedules, and allowable tension loads. The TCMST12 and TCMST14 straps have identical nail patterns; however, they vary in material thickness.

3.12 Materials:

3.12.1 Steel: The connectors described in this report are fabricated from coated carbon steel specified in Table 11, and have the following minimum base-metal thicknesses:

NOMINAL THICKNESS (gage)	MINIMUM BASE-METAL THICKNESS (inches)
No. 3	0.239
No. 7	0.179
No. 10	0.134
No. 11	0.120
No. 12	0.105
No. 14	0.0747
No. 16	0.0598
No. 18	0.0478
No. 20	0.0359

For **SI**: 1 inch = 25.4 mm.

3.12.2 Wood: Wood members must be sawn lumber or structural glued laminated lumber (glulam) with a minimum assigned specific gravity of 0.50 or structural composite lumber (SCL), such as laminated veneer lumber (LVL), with a minimum equivalent specific gravity of 0.50, unless otherwise noted in the applicable table within this report. Wood members must have a moisture content not exceeding 19 percent (16 percent for glulam and SCL), except as noted in Section 4.1. The modulus of elasticity for glulam and SCL must be a minimum of 1.4x106 psi (9.65 MPa). The thickness of the supporting wood member (header) must be equal to or greater than the length of the fasteners specified in the tables in this report, or as required

by wood member design, whichever is greater. For installations in SCL, minimum allowable nail or bolt spacing, edge distance and end distance, as specified in the applicable evaluation report for the SCL, must be met. Refer to Section 3.12.4 for issues related to connectors and fasteners used in contact with preservative-treated or fire-retardant-treated.

3.12.3 Fasteners: Required fastener types and sizes for use with the Tobin Steel structural wood connectors described in this report are specified in this section and in the applicable tables of this report.

Bolts used with connectors described in this report must be hex head bolts complying with ASTM A307, Grade A, and ANSI/ASME Standard B18.2.1. Bolt diameters must be as specified in the applicable tables of this report.

Nails used for connectors described in this report must comply with the steel wire material requirements, physical properties, tolerances, workmanship, protective coating and finishes, certification, and packaging and package marking requirements specified in ASTM F1667. The nails must have minimum fastener dimensions and minimum specified bending yield strengths (F_{yb}), determined according to ASTM F1575, as shown in Table 12.

The required number of N16 smooth shank and N54A angular-ring shank nails is supplied by the Tobin Steel Company with each connector that requires these nails for installation as shown in Tables 3, 5, 6 and 8.

3.12.4 Connectors and Fasteners Used with Treated Wood: Connectors and fasteners used in contact with preservative-treated or fire-retardant-treated wood must comply with IBC Section 2304.10.6 (2018 IBC Section 2304.10.5; 2015, 2012 and 2009 IBC Section 2304.9.5) or IRC Section R317.3, as applicable. The lumber treater or the holder of this report (Tobin Steel Company), or both, must be contacted for recommendations on the appropriate level of corrosion resistance to specify for the connectors and fasteners, as well as the connection capacities of the fasteners used with the specific proprietary preservative-treated or fire-retardant-treated lumber.

4.0 DESIGN AND INSTALLATION

4.1 Design:

The tabulated allowable loads shown in this report are for use in allowable stress design (ASD) and include the load duration factor, C_D , corresponding with the applicable loads in accordance with the NDS.

Tabulated allowable loads apply to products connected to wood used under dry conditions and where sustained temperatures are 100°F (37.8°C) or less. When products are installed in wood having a moisture content greater than 19 percent (16 percent for engineered wood products), or where wet service is expected, all tabulated loads for connections must be adjusted by the wet service factor, C_M . specified in the NDS for dowel-type fasteners. When connectors are installed in wood that will experience sustained exposure to temperatures exceeding 100°F (37.8°C), the allowable loads in this report must be adjusted by the applicable temperature factor, C_t , specified in the NDS. The group action factor, C_g , has been accounted for in accordance with Section 11.3.6 of the 2018 and 2015 NDS (Section 10.3.6 of the 2012 and 2005 NDS for the 2012 and 2009 IBC) where applicable in the tabulated allowable loads in this report.

For connectors installed with bolts, minimum edge distances and end distances within the wood members must be such that the geometry factor, C_{Δ} , is 1.0, in accordance with Section 12.5.1 of the 2018 and 2015 NDS (Section 11.5.1 of the 2012 and 2009 NDS for the 2012 and 2009 IBC).

Connected wood members must be analyzed for loadcarrying capacity at the connection in accordance with the NDS.

4.2 Installation:

Installation of the connectors must be in accordance with this evaluation report and the manufacturer's published installation instructions. Connector location must comply with the approved construction documents. Bolts installed in engineered wood must be installed in accordance with the applicable provisions of the NDS or the evaluation report for the engineered wood, whichever is more restrictive. In the event of a conflict between this report and the manufacturer's published installation instructions, this report governs.

5.0 CONDITIONS OF USE

The Tobin Steel structural wood hangers and connectors described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The connectors must be manufactured, identified and installed in accordance with this report and the manufacturer's published installation instructions. A copy of the instructions must be available at the jobsite at all times during installation.
- 5.2 Calculations showing compliance with this report must be submitted to the code official. The calculations must be prepared by a registered design professional where required by the statues of the jurisdiction in which the project is to be constructed.
- 5.3 Use of connectors with preservative- or fire retardanttreated lumber must be in accordance with Section 3.12.4 of this report.
- 5.4 The connector products are manufactured under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Joist Hangers and Similar Devices (AC13), dated October 2018 (editorially revised December 2020).

7.0 IDENTIFICATION

- 7.1 The ICC-ES mark of conformity, electronic labeling, or the evaluation report number (ICC-ES ESR-1822) along with the name, registered trademark, or registered logo of the report holder must be included in the product label.
- 7.2 In addition, each connector described in this report must be identified by a label with the product model number.
- **7.3** The report holder's contact information is the following:

TOBIN STEEL COMPANY, INC. 817 EAST SANTA ANA BOULEVARD SANTA ANA, CALIFORNIA 92701 (714) 541-2268

www.tobinsteel.com

TABLE 1—TECC AND TCC SERIES COLUMN CAPS^{1,5,6}

MODEL	MODEL		COLUN	IN CAP DIME (inches)	ENSIONS		BOL (quantity) -		ALLOWABLE LOADS (lbf)		
MODEL SERIES	MODEL NO.	Width for Beam	Width for Post	Bearing Length for	U-Channel Height for	Steel Thickness	Beam	Post	Uplift ³ C _D = 1.6	Down⁴ C _D = 1.0	
	TEOOS 4/4 4	(BW)	(PW)	Beam (L)	Beam (H)		(4) 5/#	(0) 5/ "			
	TECC3-1/4-4	31/4	3 ⁵ / ₈	9	6 ¹ / ₂	³ / ₁₆	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	6,960	17,570	
	TECC3-1/4-6	31/4	5 ⁵ / ₈	9	61/2	³ / ₁₆	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	6,960	17,570	
	TECC44	3 ⁵ / ₈	3 ⁵ / ₈	5 ¹ / ₂	4	³ / ₁₆	$(2) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	3,930	12,030	
	TECC46	3 ⁵ / ₈	5 ⁵ / ₈ 5 ⁵ / ₈	9	6 ¹ / ₂	³ / ₁₆	$(4) - \frac{5}{8}$ " $(4) - \frac{3}{4}$ "	$(2) - \frac{5}{8}$ "	7,510	19,680	
	TECC5-1/4-6	5 ¹ / ₄		10 ¹ / ₂	8	1/4	$(4) - \frac{3}{4}$ $(4) - \frac{3}{4}$	$(2) - \frac{3}{4}$	10,940	33,630	
	TECC5-1/4-8	5 ¹ / ₄	73/8	101/2	8	1/4	. ,	$(2) - \frac{3}{4}$ "	10,940	33,630	
	TECC64	5 ¹ / ₂	3 ⁵ / ₈	9	61/2	³ / ₁₆	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	7,510	30,930	
	TECC66	5 ¹ / ₂	5 ⁵ /8	9	6 ¹ / ₂	³ / ₁₆	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$	7,490	30,930	
TECC	TECC68	5 ¹ / ₂ 6 ⁷ / ₈	7 ³ / ₈ 5 ⁵ / ₈	9 10 ¹ / ₂	61/2	³ / ₁₆	$(4) - \frac{5}{8}$ " $(4) - \frac{3}{4}$ "	$(2) - \frac{5}{8}$ " $(2) - \frac{3}{4}$ "	7,490	30,930	
	TECC76 TECC77	6 ⁷ / ₈	6 ⁷ / ₈	10 ¹ / ₂	8 8	⁹ /16	$(4) - \frac{3}{4}$ $(4) - \frac{3}{4}$	$(2) - \frac{3}{4}$	10,530	44,290	
	TECC77	6 ⁷ /8	7 ³ / ₈	10 ⁻ / ₂	8	1/4	$(4) - \frac{3}{4}$ $(4) - \frac{3}{4}$	$(2) - \frac{3}{4}$	10,920	44,290	
				10 ⁻ / ₂			$(4) - \frac{3}{4}$ $(4) - \frac{3}{4}$	` '	10,920	44,290	
	TECC86	71/2	5 ⁵ / ₈	10 ¹ / ₂	8	1/ ₄		()	10,920 10,920	49,220 49,220	
	TECC88	7 ¹ / ₂ 8 ⁷ / ₈	7 ³ / ₈ 5 ⁵ / ₈	10 ¹ / ₂	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ " $(2) - \frac{3}{4}$ "	,	· · · · · · · · · · · · · · · · · · ·	
	TECC96		7 ³ / ₈		_	1/4	$(4) - \frac{3}{4}$ " $(4) - \frac{3}{4}$ "		10,920	57,420	
	TECC98	8 ⁷ / ₈	7°/8	10 ¹ / ₂	8	'/4	(4) – 74	$(2) - \frac{3}{4}$ "	10,920	57,420	
	TECC106	91/2	5 ⁵ / ₈	10 ¹ / ₂	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	60,700	
	TCC3-1/4-4	31/4	3 ⁵ / ₈	11	61/2	3/16	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	6.960	21,480	
	TCC3-1/4-6	31/4	5 ⁵ /8	11	61/2	3/16	$(4) - \frac{5}{8}$	$(2) - \frac{5}{8}$	6.960	21,480	
	TCC44	35/8	3 ⁵ / ₈	7	4	³ / ₁₆	$(2) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$	3.930	15,310	
	TCC46	35/8	5 ⁵ / ₈	11	61/2	³ / ₁₆	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	7.510	24,060	
	TCC5-1/4-6	5 ¹ / ₄	5 ⁵ / ₈	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$	10,940	41,640	
	TCC5-1/4-8	5 ¹ / ₄	73/8	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$	10,940	41,640	
	TCC64	51/2	35/8	11	61/2	3/16	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	7,510	37,810	
	TCC66	5 ¹ / ₂	5 ⁵ / ₈	11	61/2	3/16	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	7,490	37,810	
TCC	TCC68	5 ¹ / ₂	73/8	11	6 ¹ / ₂	3/16	$(4) - \frac{5}{8}$ "	$(2) - \frac{5}{8}$ "	7,490	37,810	
	TCC76	6 ⁷ / ₈	5 ⁵ / ₈	13	8	3/16	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$	10,530	54,840	
	TCC77	67/8	67/8	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	54,840	
	TCC78	6 ⁷ / ₈	73/8	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	54,840	
	TCC86	71/2	5 ⁵ / ₈	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$	10,920	60,930	
	TCC88	71/2	73/8	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$	10,920	60,930	
	TCC96	87/8	5 ⁵ / ₈	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	71,090	
	TCC98	8 ⁷ / ₈	73/8	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	71,090	
	TCC106	91/2	5 ⁵ / ₈	13	8	1/4	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,920	75,150	

¹The wood post depth must be equal to the connector's width for the beam (BW).

²Bolts must comply with Section 3.12.3.

³The tabulated allowable uplift loads are based on the lesser of capacities from either of the bolts in double-shear in the beam or in the post.

 $^{^4}$ The tabulated allowable downloads are based upon allowable beam bearing and bolt double-shear capacity. The tabulated allowable downloads are based on a duration of load of C_D = 1.0 and must not be increased by higher load duration factors. Tabulated values for download are based on $F_{c\perp}$ = 650 psi for glulam and $F_{c\perp}$ = 625 psi for sawn-lumber. When the wood being used has a lower $F_{c\perp}$ value, the allowable download values must be reduced proportionately.

⁵The designer must determine that the capacity of the post, the beam and the post bearing is adequate to carry the applied load.

⁶The allowable loads are not applicable to column caps supporting a spliced beam condition.

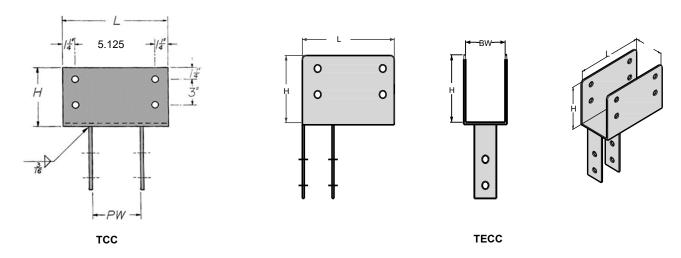


FIGURE 1—TYPICAL TCC and TECC COLUMN CAP CONNECTORS

TABLE 2—TF SERIES PANELIZED ROOF HANGERS¹

		H	IANGER DII	MENSIONS	(in.)	FASTENER	ALLOWABLE DOWNLOADS ³ (lbf)			
MODEL NO.	NOMINAL JOIST SIZE	Joist		Top Flange (Header)		SCHEDULE ²	C = 10	C = 1.15	C = 1 25	
	JOIOT GIZE	Width	Height	Depth	Length	(Quantity-Size)	$C_{D} = 1.0$	C _D = 1.15	C _D = 1.25	
TF24	2 x 4	1 ⁹ / ₁₆	31/2	1 ⁷ / ₁₆	21/2	2-10d	620	620	620	
TF26	2 x 6	1 ⁹ / ₁₆	5 ³ / ₈	1 ⁷ / ₁₆	21/2	2-10d	620	620	620	
TF34	3 x 4	2 ⁵ / ₈	31/2	1 ⁷ / ₁₆	31/2	2-10d	730	730	730	
TF36	3 x 6	2 ⁵ / ₈	5 ³ / ₈	1 ⁷ / ₁₆	31/2	2-10d	730	730	730	
TF44	4 x 4	3 ⁹ / ₁₆	31/2	1 ⁷ / ₁₆	41/2	2-10d	810	810	810	
TF46	4 x 6	3 ⁹ / ₁₆	5 ³ / ₈	1 ³ / ₈	41/2	2-10d	810	810	810	

For **SI:** 1 inch = 25.4 mm, 1 psi = 6.89 kPa, 1 lbf = 4.45 N.

 $^{^1}$ The TF series hangers are for panelized roof construction only. 2 Common nails are installed into the supporting header member. 3 The tabulated downloads are based on $F_{c\perp}=460$ psi. When the wood being used has a lower $F_{c\perp}$ value, the allowable download values must be reduced proportionately.

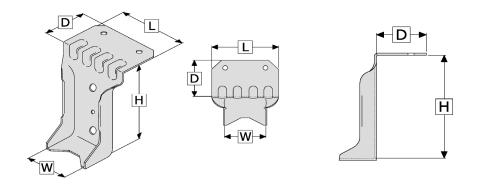


FIGURE 2—TYPICAL TF PANELIZED ROOF HANGER

TABLE 3—TVB KNEE BRACES^{1,2,3,4,5}

MODEL	BEAM DE	BEAM DEPTH (in.)		NAILING S (Quantit	_	ALLOWABLE TENSION LOADS (lbf)			
NO.	Minimum	Maximum	(feet-inches)	Each Joist (Purlin)	Beam Bottom	C _D = 1.0	C _D = 1.25	C _D = 1.6	
TVB-5	10	15	2'-6"	6-N54A	3-N54A	1,120	1,400	1,415	
TVB-7	15	22	3′–6″	6-N54A	3-N54A	1,120	1,400	1,415	
TVB-8	22	28	4'-0"	6-N54A	3-N54A	1,120	1,400	1,415	
TVB-10	28	35	5'-0"	6-N54A	3-N54A	1,120	1,400	1,415	
TVB-12	35	42	6'-0"	6-N54A	3-N54A	1,120	1,400	1,415	

For **SI:** 1 inch = 25.4 mm, 1 lbf = 4.45 N.




FIGURE 3—TYPICAL TVB KNEE BRACE INSTALLATION

¹The tabulated tension loads have been increased for the load duration specified in the table.

 $^{^2\!}A$ minimum edge distance of $1^1\!/_2$ inches must be provided for all nails.


³Joists perpendicular to the braced beam must be minimum nominal 3 x 8 [2¹/₂ x 7¹/₄ inches (64 x184 mm) actual] wood framing.


⁴The TVB knee braces must be installed at a 45-degree angle to achieve the tabulated allowable tension loads. ⁵Allowable loads shown are for tension loads along the length of the knee brace strap.

⁶N54A fastener is an annular ring shank nail (0.250-inch-diameter x 2¹/₂-inch long). See Section 3.12.3.

TABLE 4—TXC SERIES PURLIN HANGERS

						LING	,	ALLOWABLE	LOADS ^{1,2} (Ib	f)
	NOMINAL	HANGE	R DIMENSIO	ONS (in.)	_	EDULE ity–Size)		Downloads		Uplift
MODEL NO.	PURLIN SIZE	Joist Seat Width (W)	Hanger Height (H)	Joist Seat Depth (B)	Header	Joist	C _D = 1.0	C _D = 1.15	C _D = 1.25	C _D = 1.6
TXC26	2 x 6		5 ³ / ₈							
TXC28	2 x 8		71/8							
TXC210	2 x 10	1 ⁹ / ₁₆	9 ¹ / ₈	2 ¹ / ₂	2-10d	2-10d	1,730	1.730	1.785	440
TXC212	2 x 12	17/16	11	2.12	2-10d	2-10d		1,730	1,785	440
TXC214	2 x 14		13							
TXC216	2 x 16		15							
TXC36	3 x 6		5 ³ / ₈							
TXC38	3 x 8	2 ⁹ / ₁₆	7 ¹ / ₈							
TXC310	3 x 10		91/8	2 ¹ / ₂	2-10d	2-10d	2,770	2,770	2,825	475
TXC312	3 x 12		11		2-10u	2-10u	2,770	2,770	2,023	475
TXC314	3 x 14		13							
TXC316	3 x 16		15							
TXC46	4 x 6		5 ³ / ₈							
TXC48	4 x 8	3 ⁹ / ₁₆	7 ¹ / ₈	21/2	2-10d	2-10d	3,195	3,195	3,195	475
TXC410	4 x 10		9 ¹ / ₈							
TXC412	4 x 12		11							
TXC414	4 x 14	3 ⁹ / ₁₆	13	3	2-10d	2-10d	3,195	3,195	3,195	475
TXC416	4 x 16		15							
TXC26-2	(2) 2 x 6		5 ³ / ₈		_				_	_
TXC28-2	(2) 2 x 8		71/8							
TXC210-2	(2) 2 x 10	3 ¹ / ₈ 9 ¹ / ₈ 11 13	21/	2-10d	2-10d	3,195	2 105	2 105	475	
TXC212-2	(2) 2 x 12		11	21/2	2-10d	2-10d	3, 195	3,195	3,195	4/5
TXC214-2	(2) 2 x 14		\dashv							
TXC216-2	(2) 2 x 16		15	1						








FIGURE 4—TYPICAL TXC SERIES HANGER


¹Tabulated allowable downloads are based on F_{c⊥} = 460 psi. When the wood being used has a lower F_{c⊥} value, the allowable download values must be reduced proportionately.


2TXC series purlin hangers have not been rated for torsional resistance.

TABLE 5—TXD SERIES PURLIN HANGERS

		HANCE	D DIMENSION	ue1 (im)	NAILING SC	HEDULE ²	ALLOV	VABLE LOADS	S ^{3,4} (lbf)
	NOMINAL	HANGE	R DIMENSION	45* (III.)	(Quantity	–Size)	Dow	nloads	Uplift
MODEL NO.	PURLIN SIZE	Joist Seat Width (W)	Hanger Height (H)	Joist Seat Depth (B)	Header	Joist	C _D = 1.0	C _D = 1.25	C _D = 1.6
TXD46	4 x 6		5 ³ / ₈						
TXD48	4 x 8	3 ⁹ / ₁₆	71/8	31/2	4-N16	2-10d	4,430	4,430	475
TXD410	4 x 10		91/8						
TXD412	4 x 12		11						
TXD414	4 x 14	3 ⁹ / ₁₆	13	3	4-N16	2-10d	4,430	4,430	475
TXD416	4 x 16		15						
TXD418	4 x 18	3 ⁹ / ₁₆	17	31/2	4-N16	2-10d	4,430	4,30	475
TXD66	6 x 6		5 ³ / ₈						
TXD68	6 x 8	5 ⁹ / ₁₆	71/8	31/2			4,430	4,430	475
TXD610	6 x 10		9 ¹ / ₈						
TXD612	6 x 12		11		4-N16	2-10d			
TXD614	6 x 14		13						
TXD616	6 x 16		15						
TXD618	6 x 18		17						
TXD86	8 x 6		5 ³ / ₈						
TXD88	8 x 8		71/8						
TXD810	8 x 10		9 ¹ / ₈						
TXD812	8 x 12	71/2	11	31/2	4-N16	2-10d	4,430	4,430	475
TXD814	8 x 14		13						
TXD816	8 x 16		15						
TXD818	8 x 18		17						
TXD 2.6	2 ⁵ / ₈ " LVL	211/16	SPEC (5 ³ / ₈ to 30)	4	4-N16	2-10d	4,430	4,430	475
TXD 3.25	3 ¹ / ₈ " LVL	31/4	SPEC (6 to 28)	31/2	4-N16	2-10d	4,430	4,430	475
TXD 5.25	5 ¹ / ₈ " LVL	5 ¹ / ₄	SPEC (6 to 28)	31/2	4-N16	2-10d	4,430	4,430	475

⁴TXD series purlin hangers have not been rated for torsional resistance.








FIGURE 5—TYPICAL TXD SERIES HANGER

¹SPEC = specify; see table for applicable range. ²N16 nails ae 0.162 inch diameter x $2^{1}/_{2}$ inch long. See Section 3.12.3.

³The tabulated allowable downloads are based on F_{c⊥} = 460 psi. When the wood being used has a lower F_{c⊥} value, the allowable download values must be reduced proportionately.

TABLE 6—TGLT/THGLT BEAM HANGERS

		MEMBER	HANGE	R DIMENSIO	ONS² (in.)		CHEDULE ³ ty–Size)	ALLOWABLE LOADS ⁴ (lbf)				
SERIES	MODEL	WIDTH	Joist	Hanger	Тор	Carrying	Carried	Uplift		Downloads		
	NO.	(inch) AND TYPE ¹	Width (H) Length (L)	Member	Member	C _D = 1.6	C _D = 1.0	C _D = 1.15	C _D = 1.25			
	TGLT 2.6	2 ¹ / ₂ GLB	2 ⁵ / ₈	SPEC	10	10-N54A	6-N54A	1,385	7,315	7,470	7,570	
	TGLT 3	3 ¹ / ₈ GLB	31/4	SPEC	10	10-N54A	6-N54A	1,385	7,450	7,610	7,710	
	TGLT 3.5	3 ¹ / ₂ SOLID	3 ⁹ / ₁₆	SPEC	10	10-N54A	6-N54A	1,385	7,450	7,610	7,710	
TGLT	TGLT 5	5 ¹ / ₈ GLB	5 ¹ / ₄	SPEC	12	10-N54A	6-N54A	1,385	9,380	7,655	9,845	
	TGLT 5.5	5 ¹ / ₂ SOLID	5 ⁹ / ₁₆	SPEC	12	10-N54A	6-N54A	1,385	8,005	8,820	8,470	
	TGLT 7	6 ³ / ₄ GLB	6 ⁷ / ₈	SPEC	12	10-N54A	6-N54A	1,385	9,380	9,655	9,845	
	TGLT 7.5	7 ¹ / ₄ SOLID	71/2	SPEC	12	10-N54A	6-N54A	1,385	8,005	8,280	8,470	
	THGLT 2.6	21/2 GLB	2 ⁵ / ₈	SPEC	12	18-N54A	6-N54A	1,385	8,570	8,730	8,830	
	THGLT 3	31/8 GLB	31/4	SPEC	12	18-N54A	6-N54A	1,385	10,450	10,605	10,710	
THGLT	THGLT 5	5 ¹ / ₈ GLB	5 ¹ / ₄	SPEC	12	18-N54A	6-N54A	1,385	10,855	11,355	11,380	
	THGLT 7	6 ³ / ₄ GLB	6 ⁷ / ₈	SPEC	12	18-N54A	6-N54A	1,385	10,855	11,355	11,380	
	THGLT 9	8 ³ / ₄ GLB	8 ⁷ / ₈	SPEC	14	18-N54A	6-N54A	1,385	11,380	11,380	11,380	




FIGURE 6A—TYPICAL TGLT SERIES **HANGER L**




FIGURE 6B—PLAN VIEW OF THE TGLT HANGER




FIGURE 6C—TYPICAL THGLT SERIES **HANGER**




FIGURE 6D—PLAN VIEW OF THE **THGLT HANGER**


¹GLB = Glulam beam; SOLID = Visually graded dimension lumber and timbers and similarly sized engineered wood products. ²SPEC = specify; applicable range is 7¹/₂ to 33 inches. ³The N54A fastener is an annular ring shank nail (0.250-inch-diameter x 2¹/₂-inch long). See Section 3.12.3.

⁴The tabulated allowable downloads for sawn lumber sizes (TGLT 3.5, 5.5 & 7.5) are based on F_{c⊥} = 460 psi for wood. The tabulated allowable downloads for glulam members are based on Fc1 = 560 psi for wood. When the wood being used has a lower Fc1 value, the allowable download values must be reduced proportionately.

TABLE 7—TLEG/TMEG/TEG SERIES

MODEL	IAH	NGER DIMENSIO	ONS ¹		HEDULE ² –Diameter	ALLOWABLE LOADS ^{3,4} (lbf)			
MODEL NO.	Beam Seat	Hanger	Top Flange	Carrying	Supported	Dowr	Uplift		
	Width (W)	Height (H)	Length (L)	Member			C _D = 1.25	C _D = 1.6	
TLEG3	31/4	5.125	12	$(4) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	10,660	11,460	3,900	
TLEG5	5 ¹ / ₄	SPEC	12	$(4) - {}^{3}/_{4}"$	$(2) - \frac{3}{4}$ "	11,660	11,460	3,900	
TLEG7	6 ⁷ / ₈	SPEC	12	$(4) - {}^{3}/_{4}"$	$(2) - \frac{3}{4}$ "	11,660	11,460	3,900	
TMEG5	5 ¹ / ₄	SPEC	12	$(6) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	12,345	13,550	3,900	
TMEG7	6 ⁷ / ₈	SPEC	12	$(6) - \frac{3}{4}$ "	$(2) - \frac{3}{4}$ "	12,345	13,550	3,900	
TEG5	5 ¹ / ₄	SPEC	12	(8) – 1"	(2) – 1"	16,415	17,265	5,375	
TEG7	6 ⁷ / ₈	SPEC	13 ¹ / ₂	(8) – 1"	(2) – 1"	17,265	17,265	5,375	
TEG9	8 ⁷ / ₈	SPEC	15 ¹ / ₂	(8) – 1"	(2) – 1"	17,265	17265	5,375	

⁴Minimum carrying member width is 5¹/₂ inches.






FIGURE 7A—TYPICAL TEG SERIES HANGER


FIGURE 7B—TYPICAL TLEG/TMEG SERIES HANGER


 $^{^{1}}$ SPEC = specify; applicable range is 9 to 33 inches. 2 Bolts must comply with Section 3.12.3. 3 The tabulated allowable downloads are based on F_{cl} = 560 psi. When the wood being used has a lower F_{cl} value, the allowable download values must be reduced proportionately.

TABLE 8—TGLS/THGLS/TGLST/THGLST BEAM SADDLE HANGERS

MODEL	HA	ANGER DIMEN	NSIONS¹ (in.)		FASTE SCHEI (Qty. Each B	DULE ²	ALLOWABLE LOADS ³ (lbf) (for each supported beam)			
NO.	Beam	Beam	Girder	Girder			Uplift	Dow	nload	Lateral ⁴
	Seat Width (W1 or W2)	Hanger Height (H1 or H2)	Saddle Width (S)	Saddle Length (L)	Carrying Member	Carried Member	C _D = 1.6	C _D = 1.0	C _D = 1.25	C _D = 1.6
TGLS3-5	31/4	SPEC	5 ¹ / ₄	6	6-N54A	6-N54A	1,390	8,890	9,110	_
TGLS3-7	31/4	SPEC	6 ⁷ / ₈	6	6-N54A	6-N54A	1,390	8,890	9,110	_
TGLS3-9	31/4	SPEC	8 ⁷ / ₈	6	6-N54A	6-N54A	1,390	8,890	9,110	_
TGLS5-5	5 ¹ / ₄	SPEC	5 ¹ / ₄	12	6-N54A	6-N54A	1,390	13,645	13,645	_
TGLS5-7	5 ¹ / ₄	SPEC	6 ⁷ / ₈	9	6-N54A	6-N54A	1,390	13,645	13,645	_
TGLS7-7	6 ⁷ / ₈	SPEC	6 ⁷ / ₈	12	6-N54A	6-N54A	1,390	13,645	13,645	_
TGLS7-9	6 ⁷ / ₈	SPEC	8 ⁷ / ₈	12	6-N54A	6-N54A	1,390	13,645	13,645	_
THGLS5	5 ¹ / ₄	SPEC	SPEC	12	14-N54A	8-N54A	1,845	15,035	15,035	_
THGLS7	6 ⁷ / ₈	SPEC	SPEC	12	14-N54A	8-N54A	1,845	15,035	15,035	_
THGLS9	8 ⁷ / ₈	SPEC	SPEC	12	14-N54A	8-N54A	1,845	13,035	15,035	_
TGLST3	31/4	SPEC	SPEC	12	6-N54A	6-N54A	1,390	8,890	9,150	12,555
TGLST5	5 ¹ / ₄	SPEC	SPEC	12	6-N54A	6-N54A	1,390	11,390	11,390	12,555
TGLST7	6 ⁷ / ₈	SPEC	SPEC	12	6-N54A	6-N54A	1,390	11,390	11,390	12,555
THGLST5	5 ¹ / ₄	SPEC	SPEC	12 ¹ / ₄	14-N54A	8-N54A	1,845	15,035	15,035	12,555
THGLST7	6 ⁷ / ₈	SPEC	SPEC	14	14-N54A	8-N54A	1,845	15,035	15,.035	12,555
THGLST9	8 ⁷ / ₈	SPEC	SPEC	16	14-N54A	8-N54A	1,845	15,035	15,035	12,555

⁴Three ³/₄-inch diameter bolts must be installed in the slotted holes in the tension straps on each side of carried beam. One ³/₄-inch diameter bolt located at each side of the carried beam must be installed through the carrying beam. The bolts must comply with Section 3.12.3. Lateral (tension) values are based on glulam having a minimum Stress Class of 20F-1.5E, a minimum assigned specific gravity of 0.41 and a minimum supported beam width of 3¹/₈ inch.








FIGURE 8A—TGLS HANGER

FIGURE 8B—THGLS HANGER

FIGURE 8C—TYPICALTHGLS HANGER

¹SPEC = specify; applicable range is for H is 7¹/₂ to 33 inches; applicable range for S is 5¹/₄ to 10⁷/₈ inches.

²The N54A fastener is an annular ring shank nail (0.250-inch-diameter x 2¹/₂-inch long). See Section 3.12.3.

 $^{^3}$ Tabulated allowable downloads are based on $F_{c\perp}$ = 560 psi. When the wood being used has a lower $F_{c\perp}$ value, the allowable download values must be reduced proportionately.

TABLE 9—THC/THCCT HINGE CONNECTORS

MODEL NO.	BEAM WIDTH		R BEARING DIMENSIONS (in.)		MINIMUM HANGE (Based on Num (in.	ber of Bolts)	ALLOWABLE DOWNLOADS ^{2,3,4,5} (lbf)										
NO.	(in.)	Thickness (PT)	Width (W)	Depth (PD)	2-Bolt Rotation Straps	3-Bolt Rotation Straps	Fc⊥ = 460 psi	Fc⊥ = 560									
THC 55				5	15	12	11,790	14,350									
THC 56	5 ¹ / ₈	³ / ₄	5¹/₄	6	18 ³ / ₄	14 ³ / ₄	14,145	17,220									
THC 57	5.78	74	3.74	7	23 ¹ / ₂	17 ³ / ₄	16,505	20,090									
THC 59				9	34 ¹ / ₂	25 ¹ / ₄	21,215	25,830									
THC 75		1		5	17 ³ / ₄	14	15,525	18,900									
THC 76	6³/₄		671	6	23	17 ¹ / ₂	18,630	22,680									
THC 77	0.74	ı	6 ⁷ / ₈	0 78	7	28 ³ / ₄	21 ¹ / ₂	21,735	26,460								
THC 79				9	431/2	31 ¹ / ₄	27,945	34,020									
THC 95				5	21 ¹ / ₄	16 ¹ / ₄	20,125	24,500									
THC 96	8 ³ / ₄	1 ¹ / ₄	8 ⁷ / ₈	6	28	203/4	24,150	29,400									
THC 97	0 74	1 /4	0 /8	7	35 ¹ / ₂	26	28,175	34,300									
THC 99													9	54 ¹ / ₂	383/4	36,225	44,100
THC11-5			_	5	243/4	18 ³ / ₄	24,725	30,100									
THC11-6	10³/₄	11/2	107/	6	33	24	29,670	36,120									
THC11-7	10.74		10 ⁷ / ₈	7	421/4	301/2	34,615	42,140									
THC11-9				9	65 ¹ / ₂	46	44,505	54,180									

⁵The tabulated allowable downloads are based on F_{c⊥} values shown in the table. When the wood being used has a lower F_{c⊥} value, the allowable download values must be reduced proportionately.




FIGURE 9A—TYPICAL INSTALLATION OF A THC HANGER




FIGURE 9B—TYPICAL THC HANGER




FIGURE 9C—TYPICAL THCCT HANGER

¹Minimum height shown is for the tabulated downloads. Also, the hangers must be specified with either 2- or 3-bolt rotation straps. The minimum height depends on the rotation straps specified.

²Allowable downloads are based on compression perpendicular to grain and do not include any load duration increase; none are allowed.

³The bolts must comply with Secton 3.12.3.

⁴THC connectors have two prepunched holes in each rotation strap (Figure 9B). TH3 connectors are the same as THC connectors, except they have three holes in each rotation strap (similar to Figure 9C). THC3T connectors are the same as THC3 connectors, with the addition of a steel tension strap on each side (Figure 9C).THCCT connectors are identical to the THC connectors except for the addition of two steel tension straps factory welded on each side at the center of the connectors. When three ³/₄-inch diameter bolts are installed in each tension strap, the allowable tension load is 12,555 lbf, based on glulam having a minimum Stress Class of 20F-1.5E, a minimum assigned specific gravity of 0.41 and a minimum supported beam width of ³/₈ inch.

TABLE 10—TSL, TSF, TMST, TSI, TSJ, THST, AND TCMST STRAP SERIES

							ENER	ALLOWABLE TENSION LOADS ^{2,3,4,5,6,7} (lbf)			
MODEL	MODEL NO.		STRAP D	IMENSIONS			DULE¹ ty–Size)	Na	ails	Во	lts
SERIES			kness	Width (in.)	Length (in.)	Nails	Bolts	C _D = 1.0	C _D = 1.6	C _D = 1.0	C _D = 1.6
	TSL14	(inch)	(gage)	3/4	4.05/	10.104		600	600		
			20		16 ⁵ / ₁₆	10-16d		690	690		_
	TSL10	_	20	21/16	9 ⁵ / ₁₆	12-16d	_	830	1,325	_	_
	TSL13	_	20	21/16	12 ¹³ / ₁₆	16-16d	_	1,105	1,765	_	_
	TSL15		20	21/16	16 ⁵ / ₁₆	20-16d	_	1,380	2,035	_	
	TSL16	_	16	2 ¹ / ₁₆	16 ⁵ / ₁₆	20-16d	_	1,420	2,270	_	_
TSL	TSL23	_	16	2 ¹ / ₁₆	23 ⁵ / ₁₆	28-16d	_	1,985	3,180	_	_
	TSL33	_	14	2 ¹ / ₁₆	33 ¹³ / ₁₆	40-16d	_	2,960	4,220	_	_
	TSL9	_	16	11/4	9	8-16d	_	570	910	_	_
	TSL12		16	1 ¹ / ₄	11 ⁵ / ₈	10-16d	_	710	1,135	_	_
	TSL18	_	16	1 ¹ / ₄	17 ³ / ₄	14-16d	_	995	1,590	_	
	TSL22	_	16	1 ¹ / ₄	21 ⁵ / ₈	18-16d	_	1,278	2,045	_	_
	TSF9	_	12	11/2	9	8-16d	_	645	1,030	_	_
	TSF12	_	12	1 ¹ / ₂	12	8-16d	_	645	1,030	_	_
TSF	TSF18	_	12	1 ¹ / ₂	18	8-16d	_	645	1,030	_	
	TSF24	_	12	11/2	24	8-16d	_	645	1,030	_	
	TSF30	_	12	1 ¹ / ₂	30	8-16d	_	645	1,030	_	_
	TMST27	_	12	2 ¹ / ₁₆	26 ³ / ₈	30-16d	$(4) - \frac{1}{2}$ "	2,415	3,865	1,425	2,280
	TMST37	_	12	2 ¹ / ₁₆	36 ⁷ / ₈	42-16d	$(6) - \frac{1}{2}$ "	3,380	5,410	2,015	3,225
TMST	TMST48	_	12	21/16	48	54-16d	$(6) - \frac{1}{2}$ "	4,350	5,910	2,015	3,225
	TMST60	_	10	2 ¹ / ₁₆	59 ⁵ / ₈	68-16d	$(8) - \frac{1}{2}$	6,020	6,530	2,620	4,190
	TMST72		10	2 ¹ / ₁₆	72	68-16d	$(8) - \frac{1}{2}$	6,020	6,530	2,620	4,190
	TSI26		12	2 ¹ / ₁₆	25	26-10d	_	1,690	2,705		_
	TSI36		12	21/16	35	36-10d	_	2,340	3,745		
TSI	TSI48		12	2 ¹ / ₁₆	47	48-10d	_	3,125	4,995	_	_
	TSI60		12	2 ¹ / ₁₆	59	60-10d	_	3,905	6,005	_	
	TSI72		12	21/16	72	72-10d		4,685	6,005	_	
	TSJ9		16	11/4	9	8-10d	_	470	750	_	
	TSJ12		16	11/4	12	10-10d		585	935		
	TSJ15		16	1 /4	15	12-10d		700	1,120		
TSJ	TSJ18		16	1 /4	18	14-10d		820	1,310		
, 50	TSJ24		16	11/4	24	18-10d		1,050	1,685		
	TSJ24		16	11/4	30	22-10d	_	1,030	2,060		
	TSJ36		16	11/4	36	26-10d	_	1,520	2,060		
	THST2						$-$ (6) $ ^{5}/_{8}$ "	1,520			E 460
	THST3	³ / ₁₆	_	2 ¹ / ₂	21 ¹ / ₄ 25 ¹ / ₂	_	$(6) - \frac{3}{8}$ $(6) - \frac{3}{4}$		_	3,415	5,460
THST			_			_	$(6) - \frac{3}{4}$ $(12) - \frac{5}{8}$	_	_	4,985	7,980
	THST5	3/16		5	21 ¹ / ₄					6,840	10,940
	THST6	1/4	- 40	6	25 ¹ / ₂	400.407	$(12) - \frac{3}{4}$	_		9,815	15,705
	TCMST12-45"		12	3	45	100-16d			9,095		
	TCMST12-105"		12	3	105	118-10d	_		9,190	_	_
TCMST ⁸	TCMST12-208"		12	3	208	118-10d			9,190		
	TCMST14-34"	_	14	3	34	74-16d	_		6,495	_	
	TCMST14-78"		14	3	78	88-10d	_		6,565	_	_
	TCMST14-155"		14	3	155	88-10d			6,565	_	_

¹One half of the tabulated quantity of fasteners must be installed in each wood member forming the connection.

²Allowable loads have been increased for duration of load, C_D, as indicated in the table. No further increase is allowed.

³TMST and THST straps: Allowable tension loads with bolts are based on wood members having a minimum specific gravity of 0.50 and a minimum nominal thickness of 4 inches.


⁴TSI and TSJ straps: Allowable tension loads with nails are based on wood members having a minimum specific gravity of 0.50 and a minimum nominal thickness such that the nails have full embedment.

⁵Bolts must comply with Section 3.12.3.

⁶Allowable loads for nailed and bolted straps are not cumulative.

⁷Allowable tension loads are applicable only for the loading direction parallel to grain in both wood members connected by a strap.

⁸The tabulated number of fasteners is the minimum required to achieve the tabulated allowable loads.






FIGURE 10A—DRAWING SHOWING THE RELATIVE LENGTHS OF THE TSL STRAPS WITHIN THE SERIES (TSF Straps similar)




Figure 10B—DRAWING OF THE THST STRAP




FIGURE 10C—DRAWING OF THE TSJ STRAP

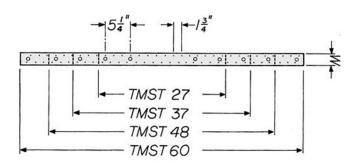


FIGURE 10D—DRAWING SHOWING THE RELATIVE LENGTHS OF THE TMST STRAPS (TMST72 similar; TSI similar, but without bolt holes)

FIGURE 10E—DRAWING OF THE TCMST12 AND TCMST14 STRAPS

TABLE 11—STEEL SPECIFICATIONS, SPECIFIED YIELD AND TENSILE STRENGTHS, AND C COATINGS

TABLE		PRODUCT	STEEL SPECIFICATION		NIMUM STEEL THS (psi)	COATING								
			SPECIFICATION	Yield, <i>F_y</i>	Tensile, F_u									
1	TECC, T	CC	ASTM A36	36,000	58,000	Painted								
2	TF		ASTM A653 Grade 33	33,000	45,000	G185 Galvanized								
	''		ASTIM A033 Grade 33	33,000	43,000	G90 Galvanized								
3	TVB		ASTM A653 Grade 33	33,000	45,000	G90 Galvanized								
4	TXC	Stirrup	ASTM A1011 Grade 33	33,000	45,000	Painted								
4	IXC	Angle	ASTM A36	36,000	58,000	Fairteu								
5	TXD	Stirrup	ASTM A1011 Grade 33	33,000	58,000	- Painted								
3	ואט	Angle	ASTM A36	36,000	58,000	- Famileu								
6	TGLT, T	HGLT	ASTM A36	36,000	58,000	Painted								
7	TLEG, T	MEG, TEG	ASTM A36	36,000	58,000	Painted								
8	TGLS, THGLS, TGLST, THGLST		ASTM A36	36,000	58,000	Painted								
9	THC, THCCT		ASTM A36	36,000 58,000		Painted								
10	TSL, TSF, TMST, TSI, TSJ, THST, TMCMST		TSL, TSF, TMST, TSI, TSJ,								ASTM A653 (Grade 50)	50,000	65,000	G90 Galvanized

For **SI:** 1 psi = 6.89 kPa.

TABLE 12—NAILS USED FOR CONNECTORS

NAIL TYPE	SHANK DIAMETER (inch)	NAIL LENGTH (inches)	F _{yb} (psi)
10d common	0.148	3	90,000
16d common	0.162	31/2	90,000
N16 smooth shank	0.162	2 ¹ / ₂	90,000
N54A angular-ring shank	0.250	21/2	80,000

For **SI:** 1 inch = 25.4 mm, 1 psi = 6.89 kPa.



ICC-ES Evaluation Report

ESR-1822 CBC and CRC Supplement

Reissued July 2023

This report is subject to renewal July 2024.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION:06 00 00—WOOD, PLASTICS AND COMPOSITES Section: 06 05 23—Wood, Plastic and Composite Fastenings

REPORT HOLDER:

TOBIN STEEL COMPANY, INC.

EVALUATION SUBJECT:

TOBIN STEEL STRUCTURAL WOOD HANGERS AND CONNECTORS

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that the Tobin Steel Structural Wood Hangers and Connectors, described in ICC-ES evaluation report ESR-1822, have also been evaluated for compliance with the codes noted below.

Applicable code editions:

■ 2022 California Building Code (CBC)

For evaluation of applicable chapters adopted by the California Office of Statewide Health Planning and Development (OSHPD) AKA: California Department of Health Care Access and Information (HCAI) and the Division of State Architect (DSA), see Sections 2.1.1 and 2.1.2 below.

■ 2022 California Residential Code (CRC)

2.0 CONCLUSIONS

2.1 CBC:

The Tobin Steel Structural Wood Hangers and Connectors, described in Sections 2.0 through 7.0 of the evaluation report ESR-1822, comply with CBC Chapter 23 provided the design and installation are in accordance with the 2021 International *Building Code*[®] (IBC) provisions noted in the evaluation report and the additional requirements of CBC Chapters 16, 17 and 23 as applicable.

2.1.1 OSHPD:

The applicable OSHPD Sections and Chapters of the CBC are beyond the scope of this supplement.

2.1.2 DSA:

The applicable DSA Sections and Chapters of the CBC are beyond the scope of this supplement.

2.2 CRC:

The Tobin Steel Structural Wood Hangers and Connectors, described in Sections 2.0 through 7.0 of the evaluation report ESR-1822, comply with CRC Chapter 3, provided the design and installation are in accordance with the 2021 *International Residential Code®* (IRC) provisions noted in the evaluation report.

This supplement expires concurrently with the evaluation report, reissued July 2023.

